



## ■ Features

- Fully isolated plastic case
- Universal AC input/Full range
- No load power consumption<0.5W
- Protections:Short circuit/Over voltage
- Withstand 300VAC Surge input for 5 seconds
- Cooling by free air convection
- Isolation class II
- 100% full load burn-in test
- 3 years warranty

## ■ Applications

- DALI Bus
- DALI Bus Powered Units


## ■ Description

The DALI Power Supply DLP-04L is a power supply with high efficiency and a small size of only 22mm thick, supplying 240mA for DALI control gears and DALI devices which without power supply circuits. The -20~+60°C wide temperature operating range can meet all kinds of applications.

It is perfectly suitable for power up any products labeled with the DALI trademark. with over 35 years of industrial power supply experience,DLP-04L is engineered to be a reliable and safe solution for DALI bus environment.

## ■ Order Name Encoding

**DLP -04 L**

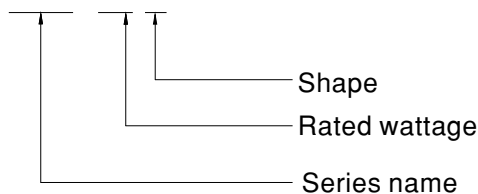





## SPECIFICATION

MODEL	DLP-04L	
OUTPUT	RATED DC VOLTAGE	16V
	DC VOLTAGE RANGE	15.3~18.7V
	RATED CURRENT	240mA(max)
	RATED POWER	3.84W
	RIPPLE & NOISE (max.) Note.2	50mVp-p
	SETUP, RISE TIME	250ms, 50ms/115VAC, 230VAC
	HOLD UP TIME (Typ.)	70ms/230VAC    16ms/115VAC at full load
INPUT	VOLTAGE RANGE	90 ~ 264VAC    120 ~ 370VDC
	FREQUENCY RANGE	47 ~ 63Hz
	AC CURRENT (Typ.)	0.4A/115VAC    0.2A/230VAC
	INRUSH CURRENT (Typ.)	COLD START    20A/230VAC
	LEAKAGE CURRENT	0.5mA / 240VAC
	NO LOAD POWER CONSUMPTION	<0.5W
PROTECTION	SHORT CIRCUIT	Protection type : Constant current limiting, recovers automatically after fault condition is removed
	OVER VOLTAGE	23.6 ~ 27V Protection type : Shut off o/p voltage, clamping by zener diode
ENVIRONMENT	WORKING TEMP.	-20 ~ +60°C (Refer to "Derating Curve")
	WORKING HUMIDITY	20 ~ 90% RH non-condensing
	STORAGE TEMP., HUMIDITY	-40 ~ +85°C, 10 ~ 95% RH
	VIBRATION	10 ~ 500Hz, 2G 10min./1cycle, period for 60min. each along X, Y, Z axes; Compliance to IEC60068-2-6
SAFETY & EMC (Note 4)	SAFETY STANDARDS	Design refer to EN61347-2-11
	DALI STANDARDS	Compliance to IEC62386-101
	WITHSTAND VOLTAGE	I/P-O/P:3KVAC
	ISOLATION RESISTANCE	I/P-O/P:100M Ohms / 500VDC / 25°C / 70% RH
	EMC EMISSION	Compliance to EN55015, EN61547, EN61000-3-2,-3
OTHERS	EMC IMMUNITY	Compliance to EN61000-4-2, 3, 4, 5, 6, 8, 11, EN55024, EN61000-6-2, EN61204-3, light industry level, criteria A
	MTBF	625.5K hrs min.    MIL-HDBK-217F (25°C)
	DIMENSION	145*38*22(W*H*D)
NOTE	PACKING	0.084Kg; 60pcs/6Kg/0.48CUFT
	1. All parameters NOT specially mentioned are measured at 230VAC input, rated load and 25°C of ambient temperature. 2. Ripple & noise are measured at 20MHz of bandwidth by using a 12" twisted pair-wire terminated with a 0.1uf & 47uf parallel capacitor. 3. The power supply is considered a component which will be installed into a final equipment. The final equipment must be re-confirmed that it still meets EMC directives.	


### Block Diagram

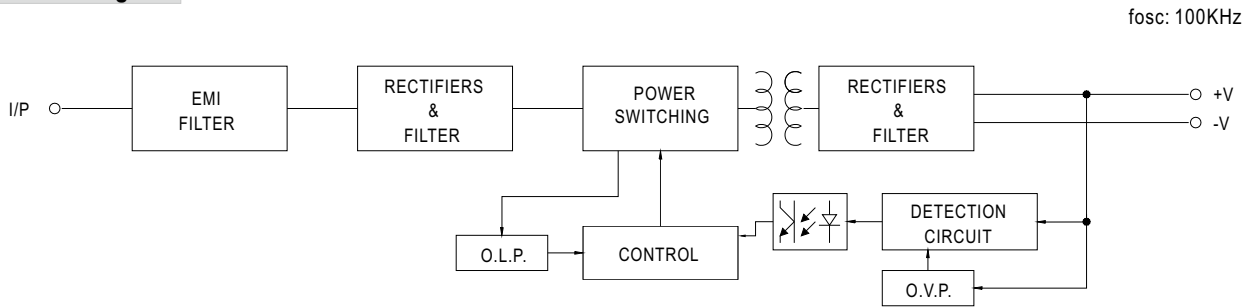

### Derating Curve

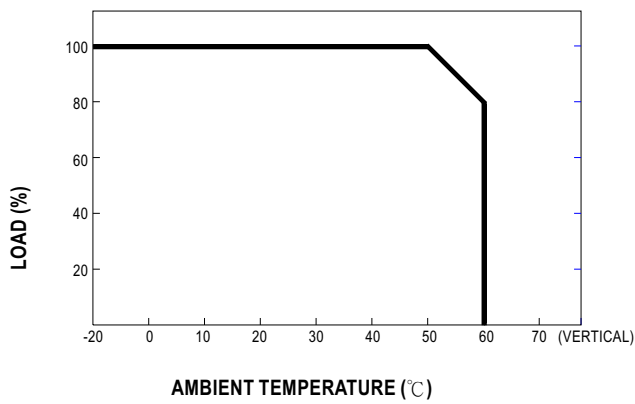


### Output Derating VS Input Voltage

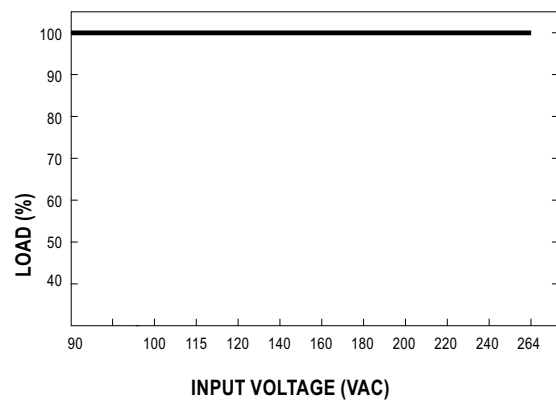

### Mechanical Specification

Case No. PLM-25 Unit: mm

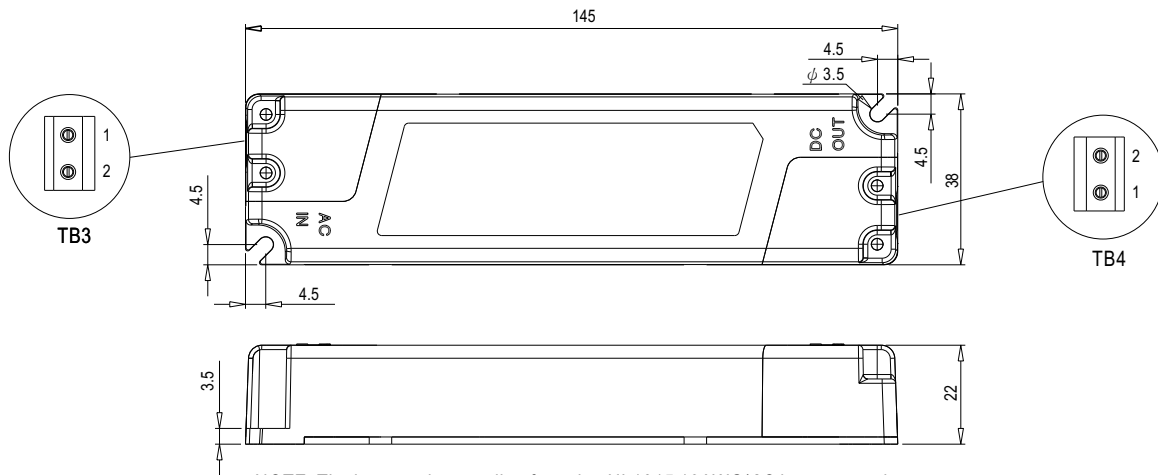

NOTE: The input and output line for using UL1015 18AWG\*2C is suggested


Terminal Pin No. Assignment (TB3) :  
SWITCHLAB MWX201-75002EB (GRAY)

Pin No.	Assignment
1	AC/N
2	AC/L

Terminal Pin No. Assignment (TB4) :  
SWITCHLAB MWX201-75002B (BLUE)

Pin No.	Assignment
1	DA-
2	DA+

■ Installation Manual

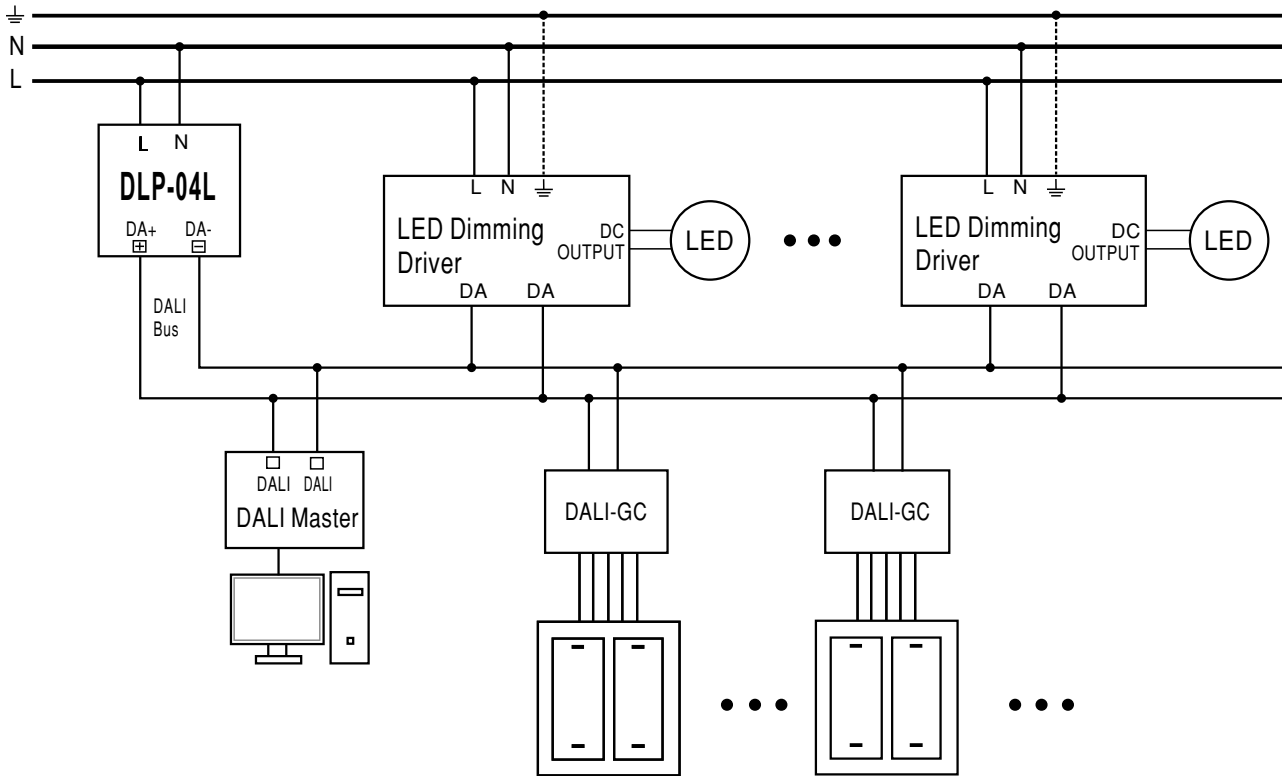

© **Cautions**

- Central DALI power supply rated at 240mA(DALI standard allows max.250mA).
- The controls interface of a DALI ballast normally source<2mA,with 64 individual addresses this will source 128mA. The remaining 112mA can be used to power other DALI controls without an internal power supply such as the DALI GC and DALI SC.
- DALI signals are not SELV.Therefore the same procedures should be applied as working with mains voltage.
- Individual DALI circuits must not exceed 240mA.
- The maximum cable length of the DALI signal wires must not exceed 300m or drop more than 2V on the signal line voltage.

■ System start-up timing


1. After external power-on, timing of a bus power supply shall be as shown in table 1.
2. A receiver shall be ready to receive frames within the maximum receiver start-up time specified in Table 1.
3. A transmitter or a multi-master transmitter shall not start transmissions earlier than the transmitter start-up time specified in Table 1.

©Table 1 – Start-up timing

	Minimum	Typical	Maximum	Condition
Bus power supply start-up time			250ms	Guaranteed supply current reached
Advanced bus power supply start-up time			400ms	
Integrated bus power supply start-up time			400ms <sup>a</sup> 5s <sup>b</sup>	
Integrated bus power supply start-up time			450ms <sup>e</sup>	
Receiver start-up time for externally powered bus units after external power cycle			100ms	U=10V <sup>d</sup>
Receiver start-up time after bus power down for bus powered bus units			1200ms	
Transmitter start-up time	110ms <sup>c</sup>			
Bus power down	110ms			

- a Applicable if other bus power supplies are allowed in the system
- b Applicable if no other bus power supplies are allowed in the system.
- c Not applicable for transmitters of bus units which cannot determine the bus state.
- d Idle state, bus voltage measured at the interface of the bus unit.
- e If an external power cycle occurred and the bus power is not available within 350 ms, the 100 ms timing is applicable.

©Shows an example of the system start-up timing

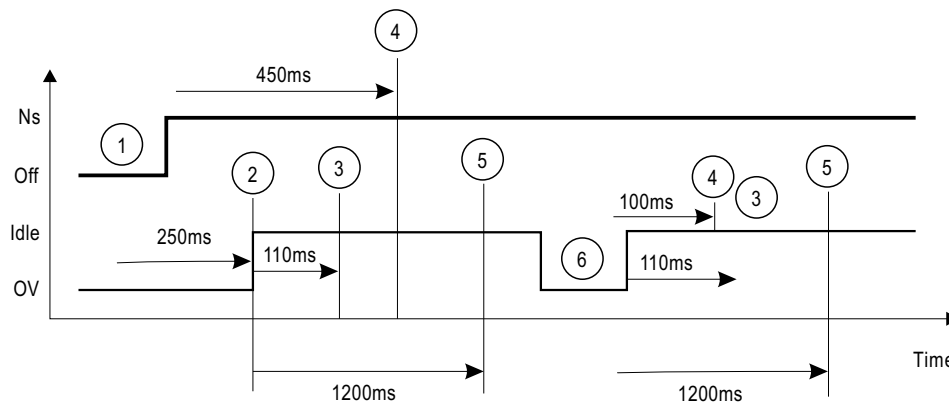

- ① External power cycle
- ② Latest bus power supply start-up
- ③ Earliest transmitter start-up
- ④ Latest receiver start-up for externally powered unit
- ⑤ Latest receiver start-up for bus powered unit
- ⑥ Bus power down