



A400/630 MOUNT. SET H=300 W=250 1 X  
 3NP4015/3NP4016 ON BUSBAR 40/60MM (WITHOUT  
 BUSBAR HOLDER) INCL. ADEQUATE COVER

Figure similar

## Accessories

<b>accessories</b>	others
--------------------	--------

<b>General Product Approval</b>	<b>Declaration of Conformity</b>	<b>Test Certificates</b>
---------------------------------	----------------------------------	--------------------------



[other](#)



[Type Test Certificates/Test Report](#)

[Special Test Certificate](#)

## Further information

**Information- and Downloadcenter (Catalogs, Brochures,...)**  
<http://www.siemens.com/lowvoltage/catalogs>


**Industry Mall (Online ordering system)**  
<https://eb.automation.siemens.com/mall/en/WW/Catalog/Product/8GK46612KK12>

**Service&Support (Manuals, Certificates, Characteristics, FAQs,...)**  
<http://support.automation.siemens.com/WW/view/en/8GK46612KK12/all>

**Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, ...)**  
[http://www.automation.siemens.com/bilddb/cax\\_en.aspx?mlfb=8GK46612KK12](http://www.automation.siemens.com/bilddb/cax_en.aspx?mlfb=8GK46612KK12)

**CAX-Online-Generator**  
<http://www.siemens.com/cax>

**Tender specifications**  
<http://ausschreibungstexte.siemens.com/tiplv>

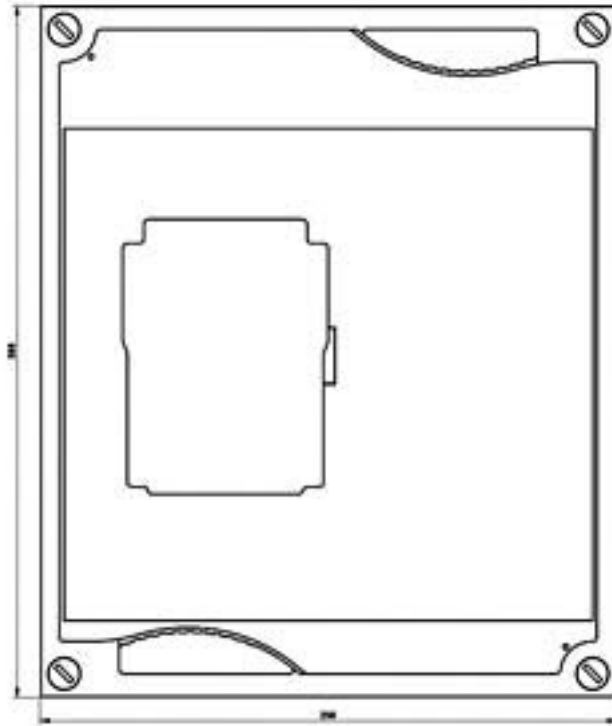

last modified:

11.03.2015