



INSTA CONTACTOR WITH 2 NC CONTACTS  
CONTACT FOR AC 230, 400V 20A ACTIVATION  
ACDC24V

Figure similar

Model		
product brand name		SENTRON
Product designation		Insta contactors
Protection class		
Protection class IP		IP20
Dissipation		
<b>Active power loss</b>		
<ul style="list-style-type: none"> <li>for rated value of the current / with AC / in hot operating state / per pole</li> </ul>	W	1.7
Main circuit		
<b>Operating voltage / Rated value</b>		
<ul style="list-style-type: none"> <li>minimum</li> </ul>	V	230
<ul style="list-style-type: none"> <li>maximum</li> </ul>	V	230
Operating current / Rated value	A	20
Control current		
Control supply voltage / Rated value	V	24
<ul style="list-style-type: none"> <li>maximum</li> </ul>	V	24
Product details		
Product component / Slide for manual operation		No
Product expansion / can be installed / supplementary devices		Yes
Number		
Number of NC contacts		2

Number of NO contacts		0
-----------------------	--	---

### Mechanical Design

Height	mm	90
Width	mm	17.5
Depth	mm	71
Installation depth	mm	64
Number of width units		1

### Certificates

Equipment marking / acc. to DIN EN 61346-2		Q
--	--	---

<b>General Product Approval</b>	<b>Declaration of Conformity</b>
---------------------------------	----------------------------------



[other](#)



### Further information

**Information- and Downloadcenter (Catalogs, Brochures,...)**

<http://www.siemens.com/lowvoltage/catalogs>

**Industry Mall (Online ordering system)**

<https://eb.automation.siemens.com/mall/en/WW/Catalog/Product/5TT50022>

**Service&Support (Manuals, Certificates, Characteristics, FAQs,...)**

<http://support.automation.siemens.com/WW/view/en/5TT50022/all>

**Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, ...)**



[http://www.automation.siemens.com/bilddb/cax\\_en.aspx?mlfb=5TT50022](http://www.automation.siemens.com/bilddb/cax_en.aspx?mlfb=5TT50022)

**CAX-Online-Generator**

<http://www.siemens.com/cax>

**Tender specifications**

<http://ausschreibungstexte.siemens.com/tiplv>

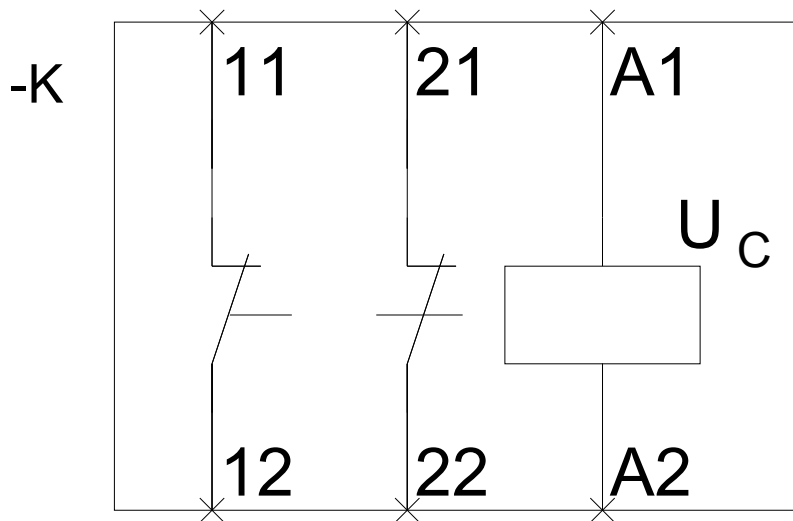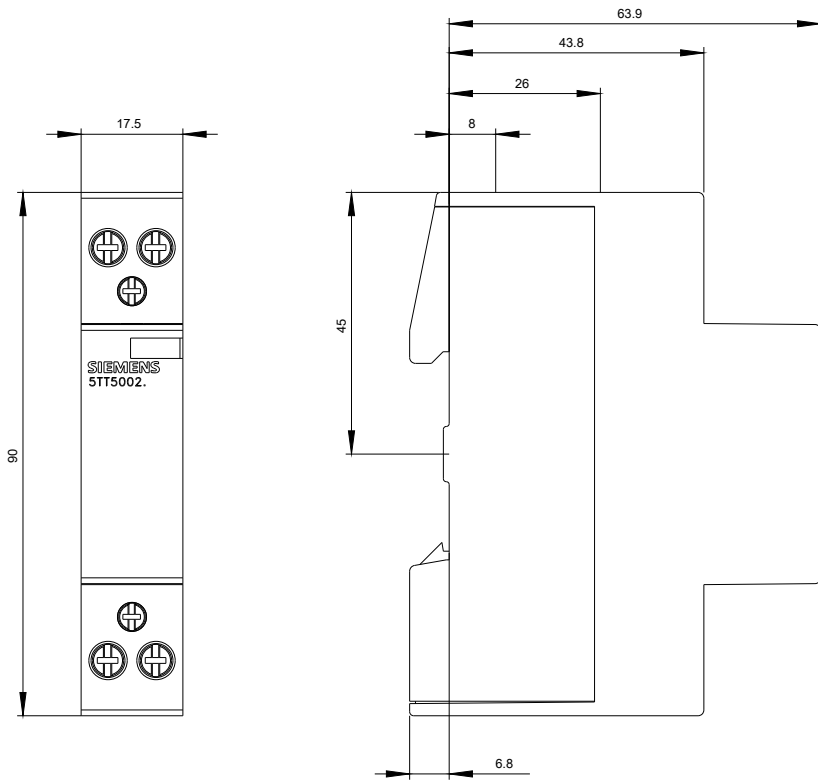

**last modified:**

11.03.2015