

UNDervOLTAGE RELEASE AC 415V, 50HZ, AC 480V, 60HZ, W. LEADING AUX. SWITCHES, 2NO, FOR CIRCUIT-BREAKER, SIZES00

### General technical data:

product brand name		SIRIUS
Product designation		undervoltage release
Size of the circuit-breaker		S00, S0, S2, S3
Design of the product		with 2 auxiliary contacts
Suitability for use		motor circuit breaker
Protection class IP on the front		IP20
Design of short-circuit protection		fuse
Degree of pollution		3
Insulation voltage Rated value	V	690
Insulation voltage with degree of pollution 3 Rated value	V	690
Ambient temperature		
• during storage	°C	-50 ... +80
• during operation	°C	-20 ... +60
Equipment marking acc. to DIN 40719 extended according to IEC 204-2 acc. to IEC 750		F
Equipment marking acc. to DIN EN 61346-2		F

### Auxiliary circuit:

Number of NC contacts for auxiliary contacts instantaneous contact		0
Number of NO contacts for auxiliary contacts instantaneous contact		0
Number of NO contacts for auxiliary contacts leading contact		2

Number of CO contacts of the auxiliary contacts instantaneous contact		0
---	--	---

#### Control circuit/ Control:

<b>Type of voltage of the control supply voltage</b>		AC
<b>Control supply voltage frequency</b>		
<ul style="list-style-type: none"> <li>• 1 <ul style="list-style-type: none"> <li>— Rated value</li> <li>— Initial rated value</li> <li>— Final rated value</li> </ul> </li> <li>• 2 Rated value</li> </ul>	     	     
<b>Control supply voltage</b>		
<ul style="list-style-type: none"> <li>• 1 <ul style="list-style-type: none"> <li>— for DC <ul style="list-style-type: none"> <li>— Rated value</li> <li>— Initial rated value</li> <li>— Final rated value</li> </ul> </li> <li>— with AC <ul style="list-style-type: none"> <li>— at 50 Hz Rated value</li> <li>— at 50 Hz Initial rated value</li> <li>— at 50 Hz Final rated value</li> <li>— at 60 Hz Rated value</li> <li>— at 60 Hz Final rated value</li> <li>— at 60 Hz Initial rated value</li> </ul> </li> </ul> </li> <li>• 2 <ul style="list-style-type: none"> <li>— for DC Rated value</li> <li>— with AC <ul style="list-style-type: none"> <li>— at 50 Hz Rated value</li> <li>— at 60 Hz Rated value</li> </ul> </li> </ul> </li> </ul>	                      	                      

#### Installation/ mounting/ dimensions:

<b>Mounting type</b>		snap-on mounting
<b>Width</b>	mm	18.5
<b>Height</b>	mm	90
<b>Depth</b>	mm	68
<b>Required spacing with side-by-side mounting</b>		
<ul style="list-style-type: none"> <li>• forwards</li> <li>• Backwards</li> <li>• upwards</li> <li>• downwards</li> <li>• at the side</li> </ul>		     
<b>Required spacing for grounded parts</b>		
<ul style="list-style-type: none"> <li>• forwards</li> </ul>		<kein Wert>

- Backwards
- upwards
- at the side
- downwards

<kein Wert>  
<kein Wert>  
<kein Wert>  
<kein Wert>

#### Required spacing for live parts

- forwards
- Backwards
- upwards
- downwards
- at the side

<kein Wert>  
<kein Wert>  
<kein Wert>  
<kein Wert>  
<kein Wert>

#### Certificates/ approvals:

##### Certificate of suitability

CE / UL / CSA

##### General Product Approval

##### Declaration of Conformity

##### Test Certificates

##### Shipping Approval



CSA



UL



EG-Konf.

[Special Test Certificate](#)



BUREAU VERITAS



RMRS

#### other

[Environmental Confirmations](#)

[Declaration of Conformity](#)

[Confirmation](#)



VDE

[other](#)

#### Further information

##### Information- and Downloadcenter (Catalogs, Brochures,...)

<http://www.siemens.com/industrial-controls/catalogs>

##### Industry Mall (Online ordering system)

<http://www.siemens.com/industrymall>

##### Cax online generator


<http://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en&mlfb=3RV19121CV1>

##### Service&Support (Manuals, Certificates, Characteristics, FAQs,...)

<http://support.automation.siemens.com/WW/view/en/3RV19121CV1/all>

##### Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...)

<http://www.automation.siemens.com/bilddb/index.aspx?attID9=3RV19121CV1&lang=en>

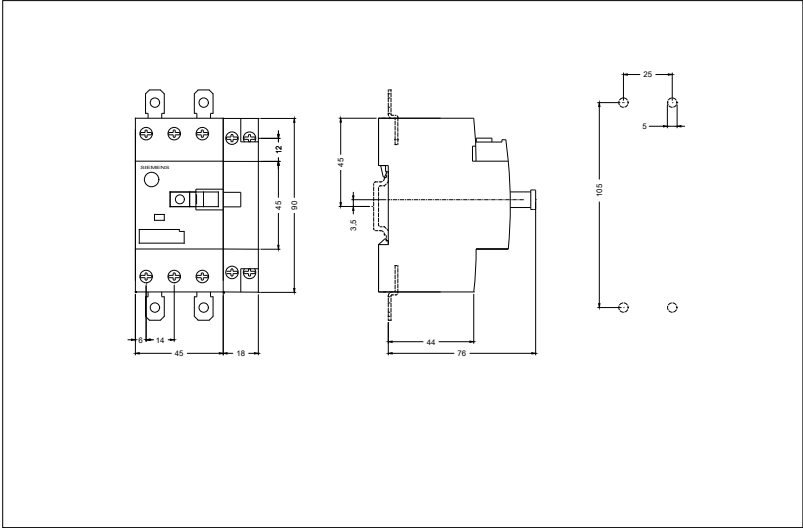

last modified:

09.03.2015